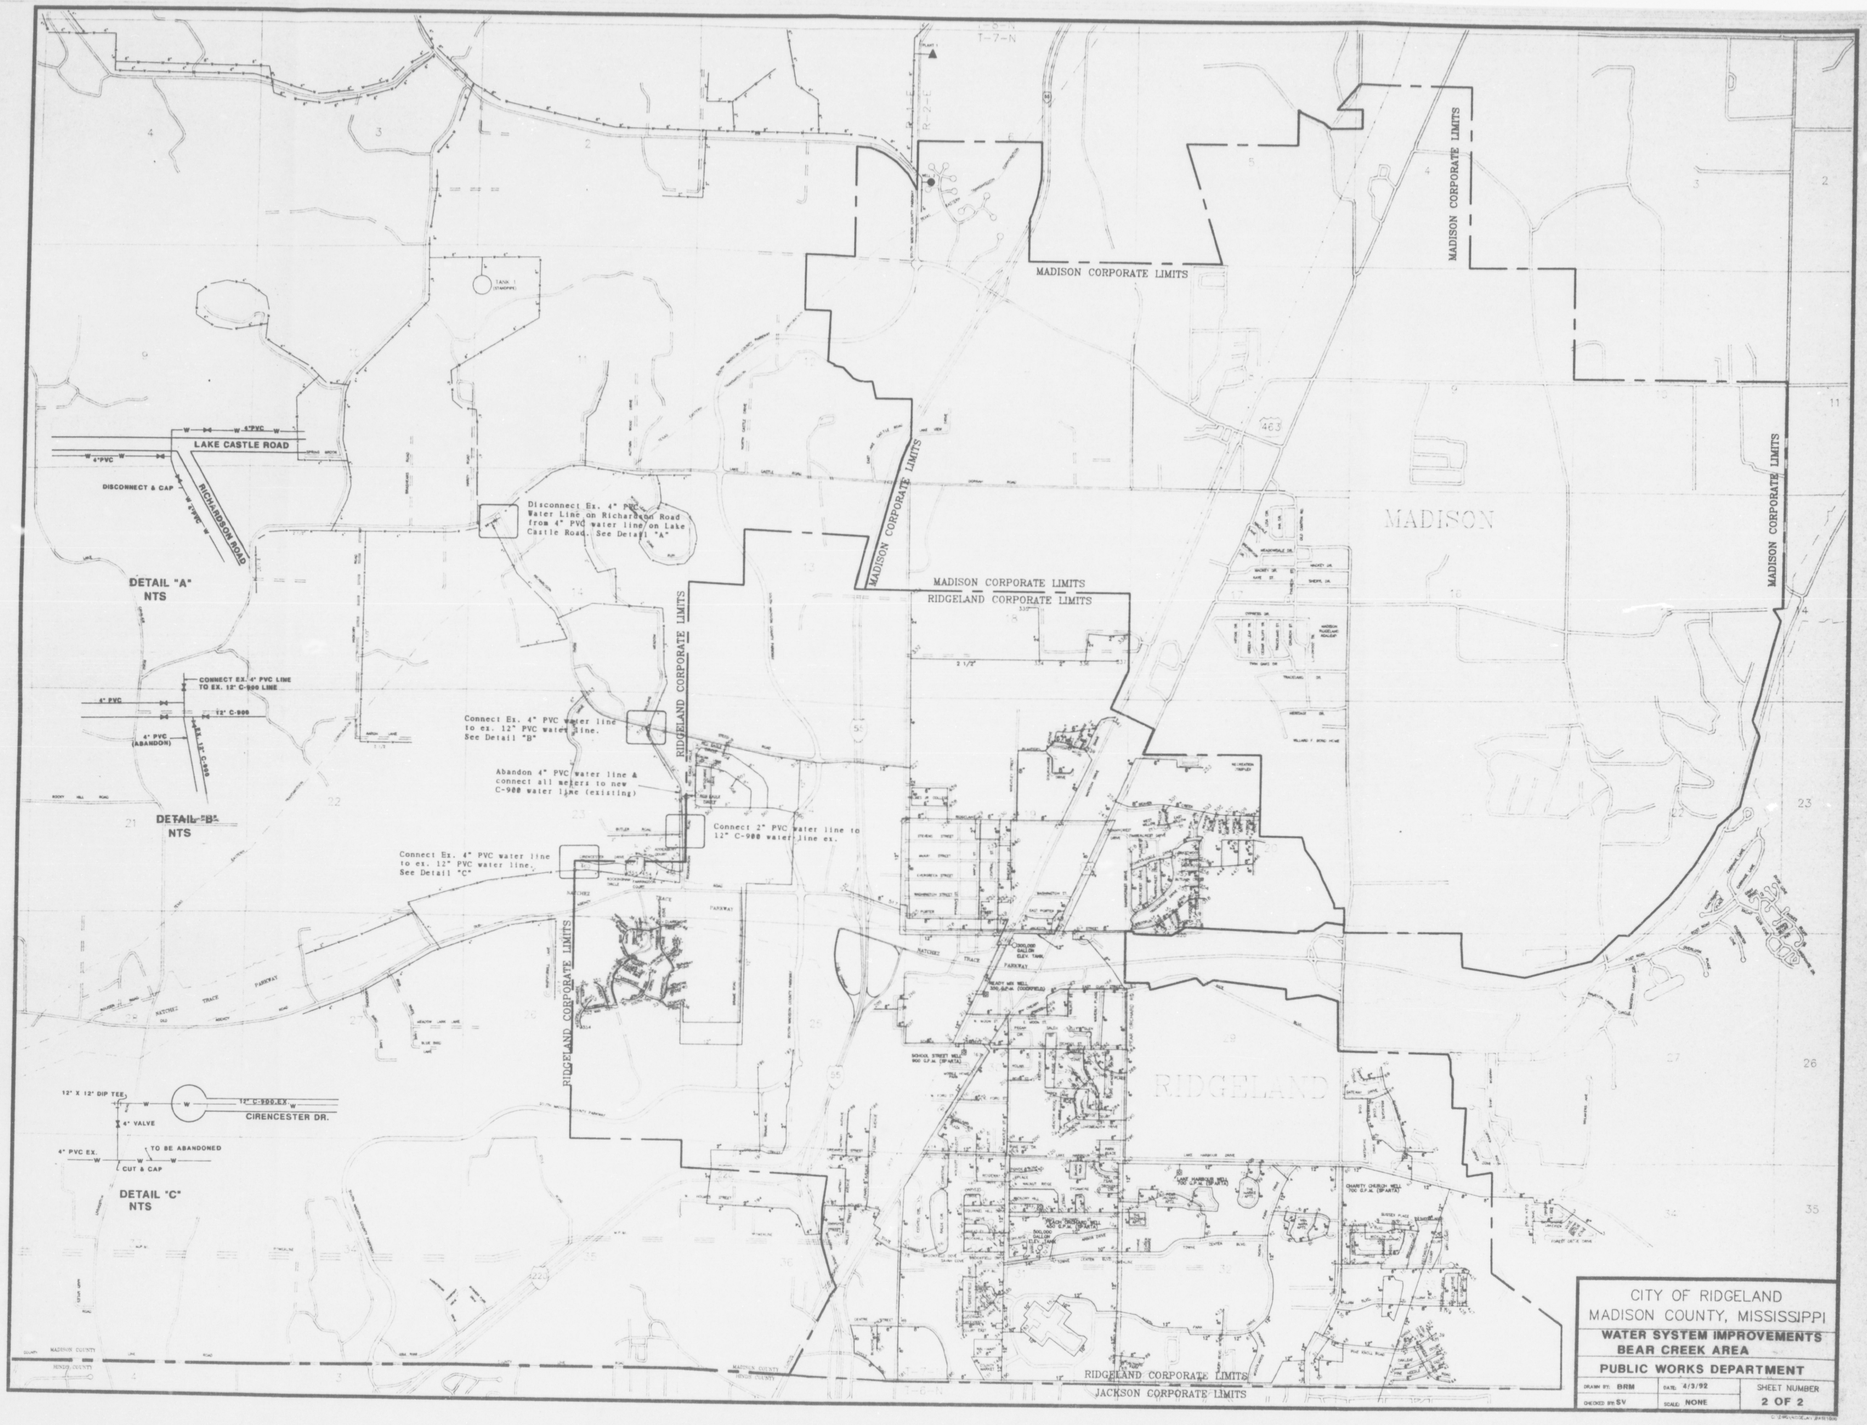
MADISON CORPORATE LIMITS
MADISON CORPORATE LIMITS
MADISON CORPORATE LIMITS
MADISON CORPORATE LIMITS
MADISON CORPORATE LIMITS
RIDGELAND CORPORATE LIMITS
RIDGELAND CORPORATE LIMITS
RIDGELAND CORPORATE LIMITS
RIDGELAND CORPORATE LIMITS
JACKSON CORPORATE LIMITS
MADISON
RIDGELAND
LAKE CASTLE ROAD
RICHARDSON ROAD
DISCONNECT & CAP
DETAIL "A"
NTS
Disconnect Ex. 4" PVC Water Line on Richardson Road from 4" PVC water line on Lake Castle Road. See Detail "A"
CONNECT EX. 4" PVC LINE TO EX. 12" C-900 LINE
4" PVC
12" C-900
4" PVC (ABANDON)
DETAIL "B"
NTS
Connect Ex. 4" PVC water line to ex. 12" PVC water line. See Detail "B"
Abandon 4" PVC water line & connect all meters to new C-900 water line (existing)
Connect 2" PVC water line to 12" C-900 water line ex.
Connect Ex. 4" PVC water line to ex. 12" PVC water line. See Detail "C"
12" X 12" DIP TEE
4" VALVE
12" C-900 EX.
CIRENCESTER DR.
4" PVC EX.
TO BE ABANDONED
CUT & CAP
DETAIL "C"
NTS
CITY OF RIDGELAND
MADISON COUNTY, MISSISSIPPI
WATER SYSTEM IMPROVEMENTS
BEAR CREEK AREA
PUBLIC WORKS DEPARTMENT
DRAWN BY: BRM
DATE: 4/3/92
SHEET NUMBER
2 OF 2
CHECKED BY: SV
SCALE: NONE