



*CITY OF RIDGELAND, MISSISSIPPI
PARKWAY WATER MAIN
NORTH OF STEED ROAD*

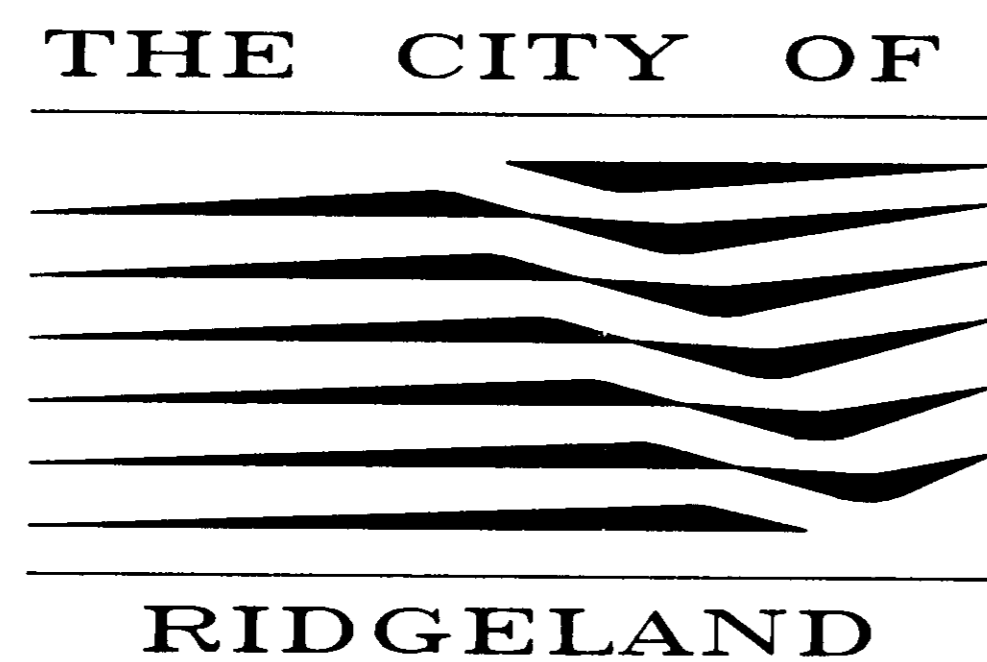

Mayor:
Gene F. McGee

Mayor Pro Tem:
Harvey Carr, Jr.

City Attorney:
Jerry Mills

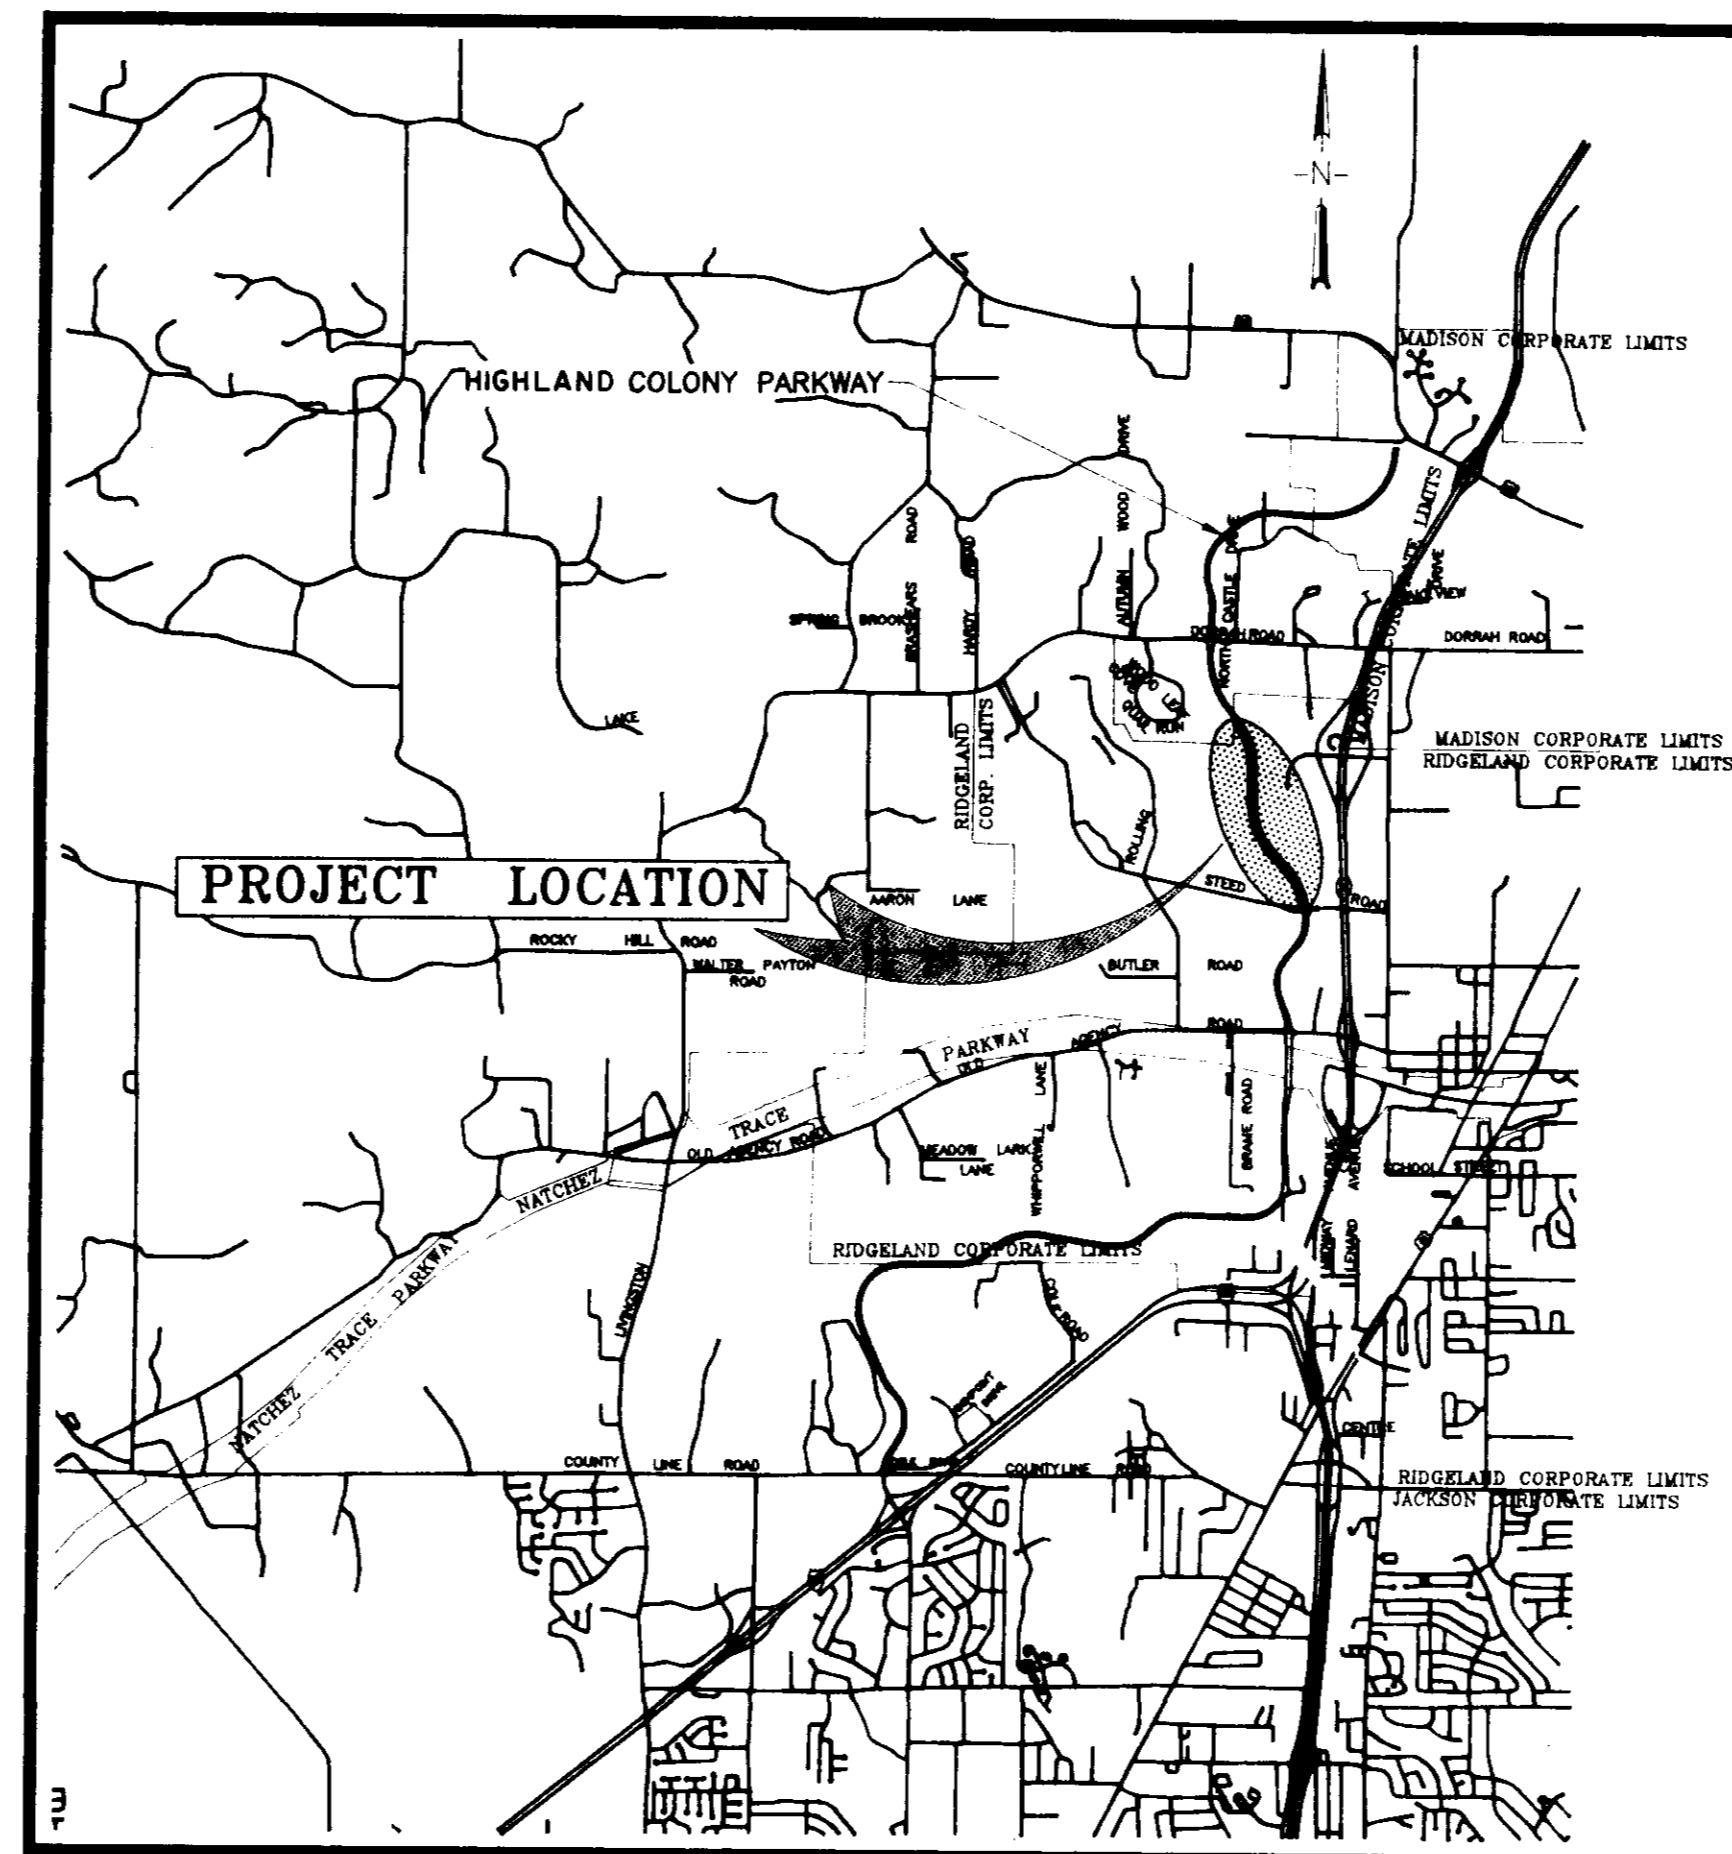

VICINITY MAP

MARCH 1993

WAGGONER ENGINEERING, INC.
CONSULTING ENGINEERS
Jackson / Brandon / Pascagoula, Mississippi

Aldermen:

*Brian Barcellona
Al Bible
Harvey Carr, Jr.
Linda Davis
Daryl Smith*

Public Works Director:
Sam Vinson, P.E.

Asst. Public Works Director:
Sid Hawthorne

City Clerk:
Michael McPhearson

Fire Chief:
Elmer Waits

Police Chief:
Charles Newell



PWP-00819

GENERAL CONSTRUCTION NOTES


1. Any existing utility locations shown on plans are approximate only. The Contractor shall coordinate the location (horizontal and vertical) of any existing utilities (power, telephone, gas, water, sewer, etc.) with the appropriate utility company before construction begins.
2. Any utility line or service line encountered during construction, whether shown on plans or not, shall be protected by the Contractor and any repairs necessary due to damage to same by the Contractor shall be at no additional cost to the Owner.
3. The Contractor shall be responsible for verifying horizontal and vertical clearances on any utility service crossings required before installation.
4. The Contractor shall fertilize and seed all areas where the existing vegetation was removed or disturbed during construction and not required to be solid sodded, paved, or graveled.
5. Unsuitable bedding, backfill or site subgrade material which may be encountered shall be excavated to the limits required and backfilled with acceptable material to the lines and grades shown on the plans.
6. Any TBM's which are or may be in conflict with construction activities shall be relocated by Engineer prior to commencement of construction in the immediate area.
7. All detailed construction staking will be by Contractor at no cost to the Owner.
8. The Contractor shall be responsible for completing all sampling and testing of materials incorporated into the project and for submission of same to Engineer for review. Prior use test results, manufacturer's certificates, or proposed mix designs shall be submitted to the Engineer for review before incorporation into project. This shall include backfill, concrete, asphalt, steel, paint, piping, fencing materials, aggregates, seed and other items as specified by the Engineer. All testing shall be an absorbed cost item.

GENERAL CONSTRUCTION NOTES (CONTINUED)


9. All testing certifications shall state that the subject material meets the specified quality, grade, purity, class or weight, or that the subject material meets or exceeds the requirement of the applicable ASTM, AASHTO, MSHD or other standards. Certifications shall be submitted to the Engineer prior to incorporation of the subject material into the project.
10. Cut zones for storm sewer, if so indicated on the Bid Form, shall be measured from the original ground profile or proposed grade, whichever is less.
11. The Contractor shall repair or replace fences that are damaged, removed or otherwise disturbed during construction. Fences shall be restored to their original condition or better using the same types of material, wire, boards, chain link, pipe, etc. as used for original construction.
12. The Contractor shall repair roadways, driveways, sidewalks, yard surfaces, curb and gutter sections, etc., disturbed during construction. Repairs shall be made by using the types of material used during original construction and to the complete satisfaction of the Owner and Engineer.
13. The Contractor shall protect trees, shrubbery, flowers, sod and other vegetation, not specified for removal by Drawings or Specifications, and shall repair or replace such items as are damaged during construction of project with the same types and quality as those that are damaged. Such repair or replacement shall be to the satisfaction of the Engineer and the Owner of the property involved.
14. The repair or replacement of items not listed on the Bid Form for separate payment, shall be considered as incidental to the project and the cost for such items shall be included in the unit price bid for Clearing and Grubbing.

INDEX TO DRAWINGS	
SHEET NO.	TITLE
1	TITLE SHEET
2	INDEX TO DRAWINGS AND GENERAL CONSTRUCTION NOTES
3	PLAN-PROFILE SHEET STA.252+50 TO STA.265+00
4	PLAN-PROFILE SHEET STA.265+00 TO STA.280+00
5	PLAN-PROFILE SHEET STA.280+00 TO STA.287+00
6	WATER STANDARD DETAIL SHEET

CITY OF RIDGELAND, MISSISSIPPI			
PARKWAY WATER MAIN NORTH OF STEED ROAD			
INDEX TO DRAWINGS AND GENERAL CONSTRUCTION NOTES			
WAGGONER ENGINEERING, INC. Consulting Engineers - Jackson, Mississippi			
DRAWN BY: C.S.	DATE: 3-11-93	SHEET NUMBER	
REVIEWED BY: W.L.M.	SCALE: NOT TO SCALE	2 OF 6	

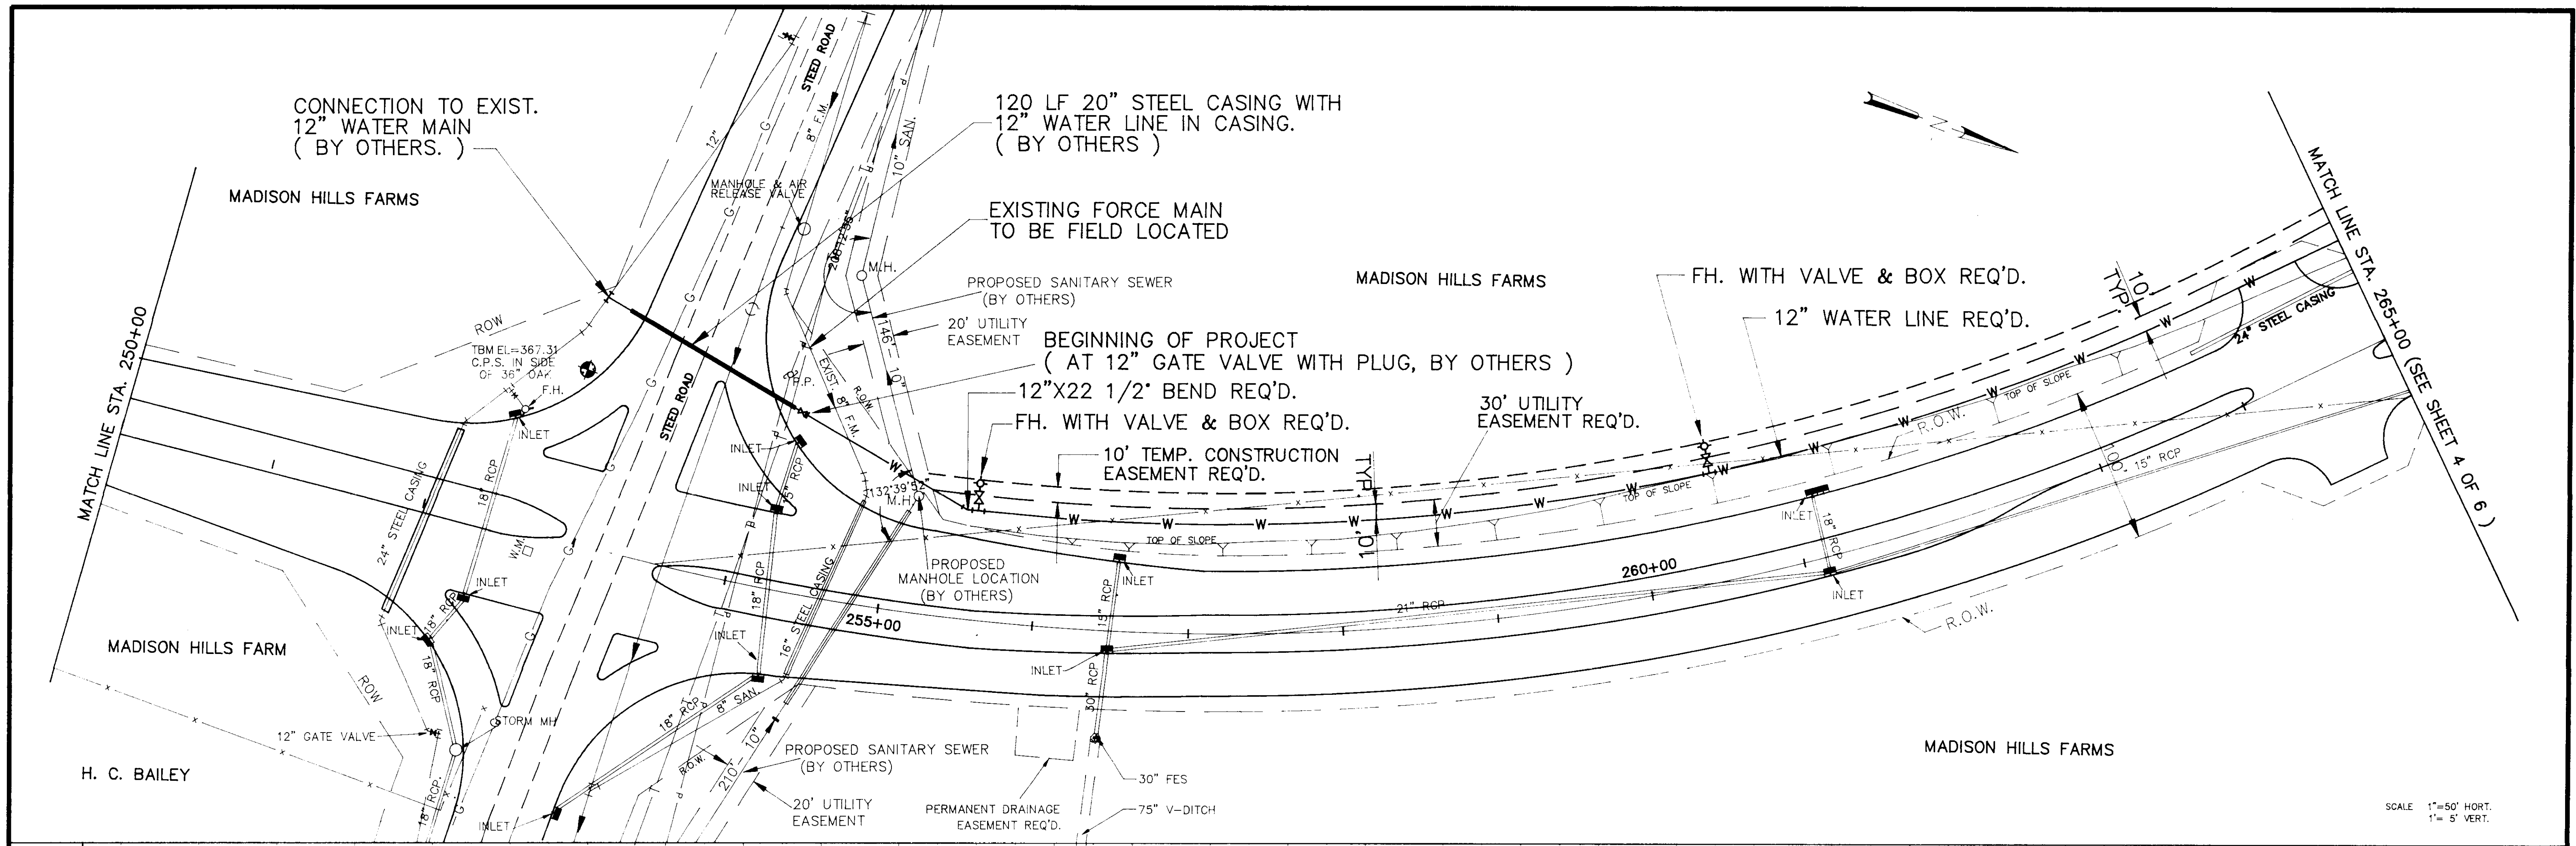

SCALE 1"=50' HORT.
1"=5' VERT.


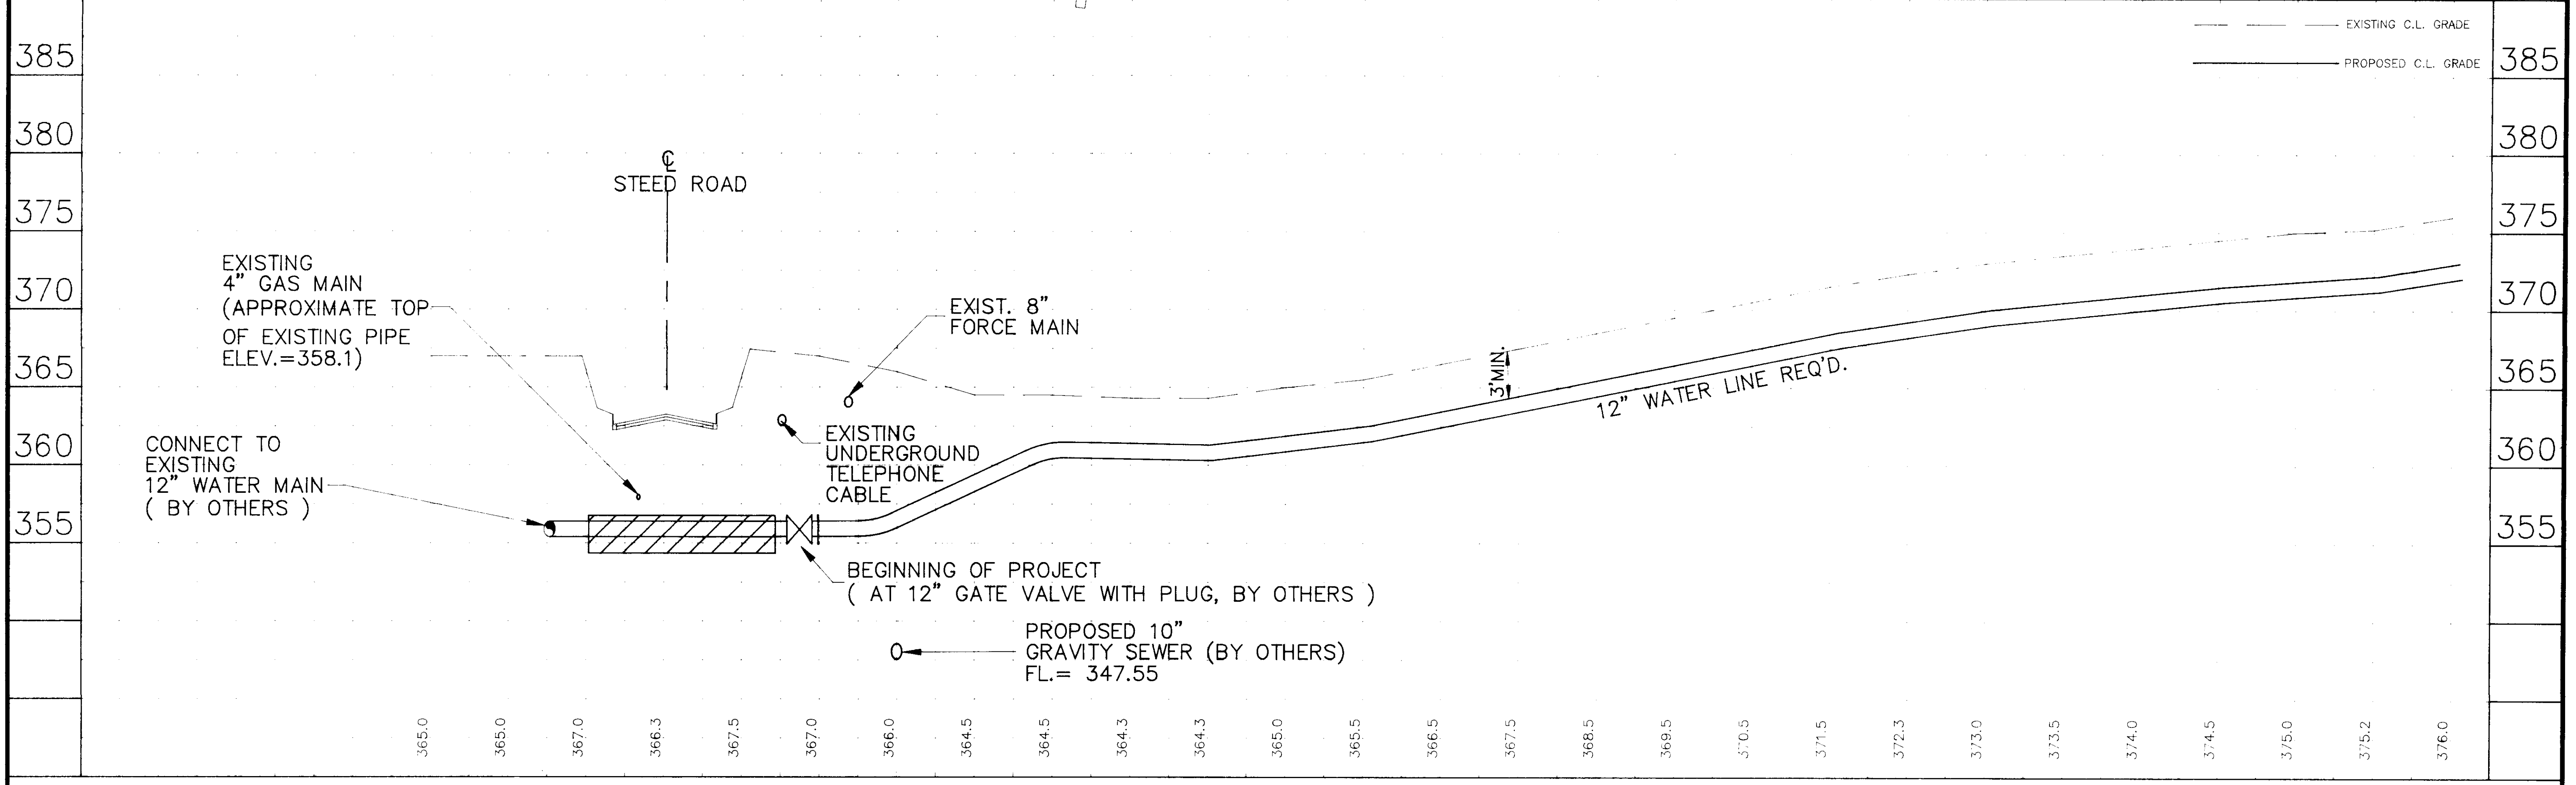


4	8-24-93	ADD TWO FIRE HYDRANTS WITH VALVES & BOXES	J.P.	DESIGNED	DATE	252+00	253+00	254+00	255+00	256+00	257+00	258+00	259+00	260+00	261+00	262+00	263+00	264+00	265+00
3	8-10-93	CHANGE CONNECTION TO EXIST. MAIN & VALVE LOCATION	J.P.	W.L.M.	3-30-93														
2	5-12-93	ADDED NOTES & REVISED TITLE BLOCK	C.S.	DRAWN	SCALE														
NO.	DATE	REVISIONS	BY	C.S.	AS SHOWN														

WAGGONER ENGINEERING INC. CONSULTING ENGINEERS
JACKSON, BRANDON / PASCAGOULA, MISSISSIPPI


CITY OF RIDGELAND
PARKWAY WATER MAIN-NORTH OF STEED RD.
STA. 252+50 TO STA. 265+00

ACAD PATH ROUTE
93019 PPR01
W.E.I. JOB NO. 93-019
SHEET NO. 3 OF 6

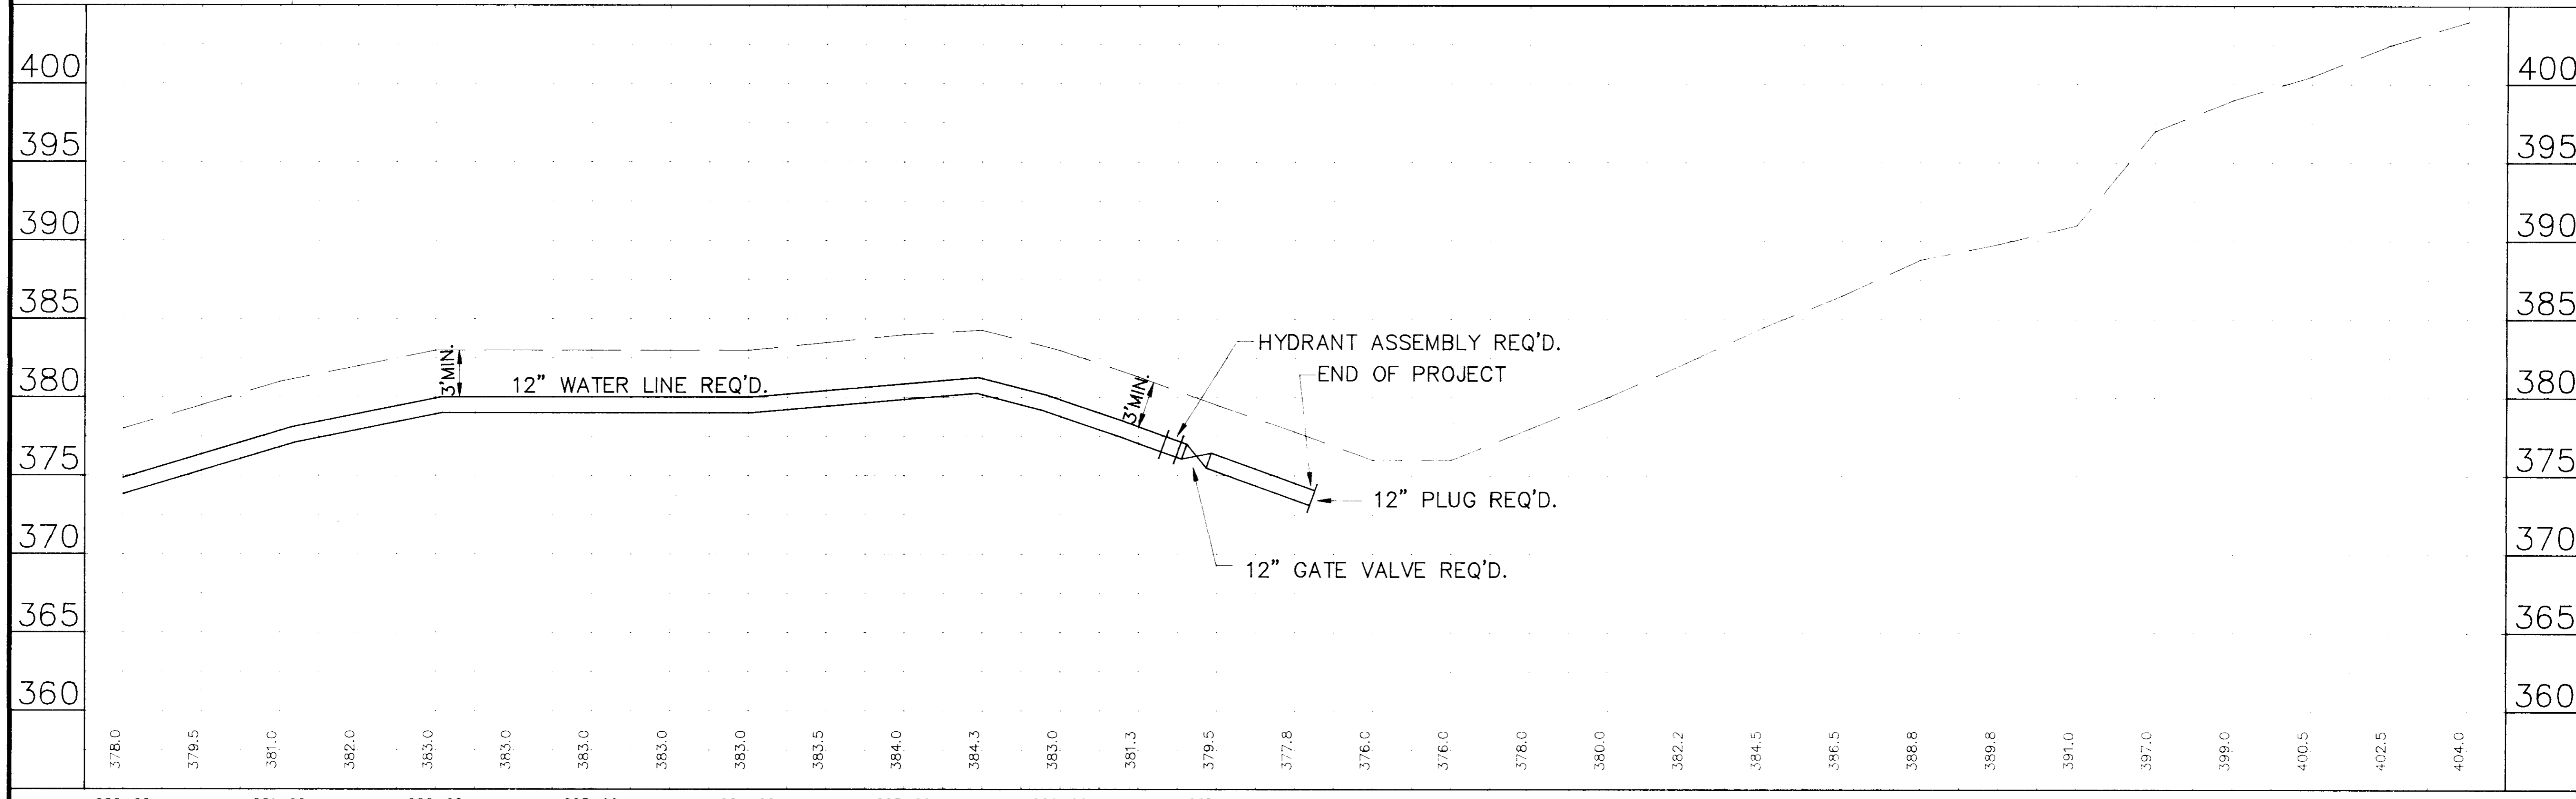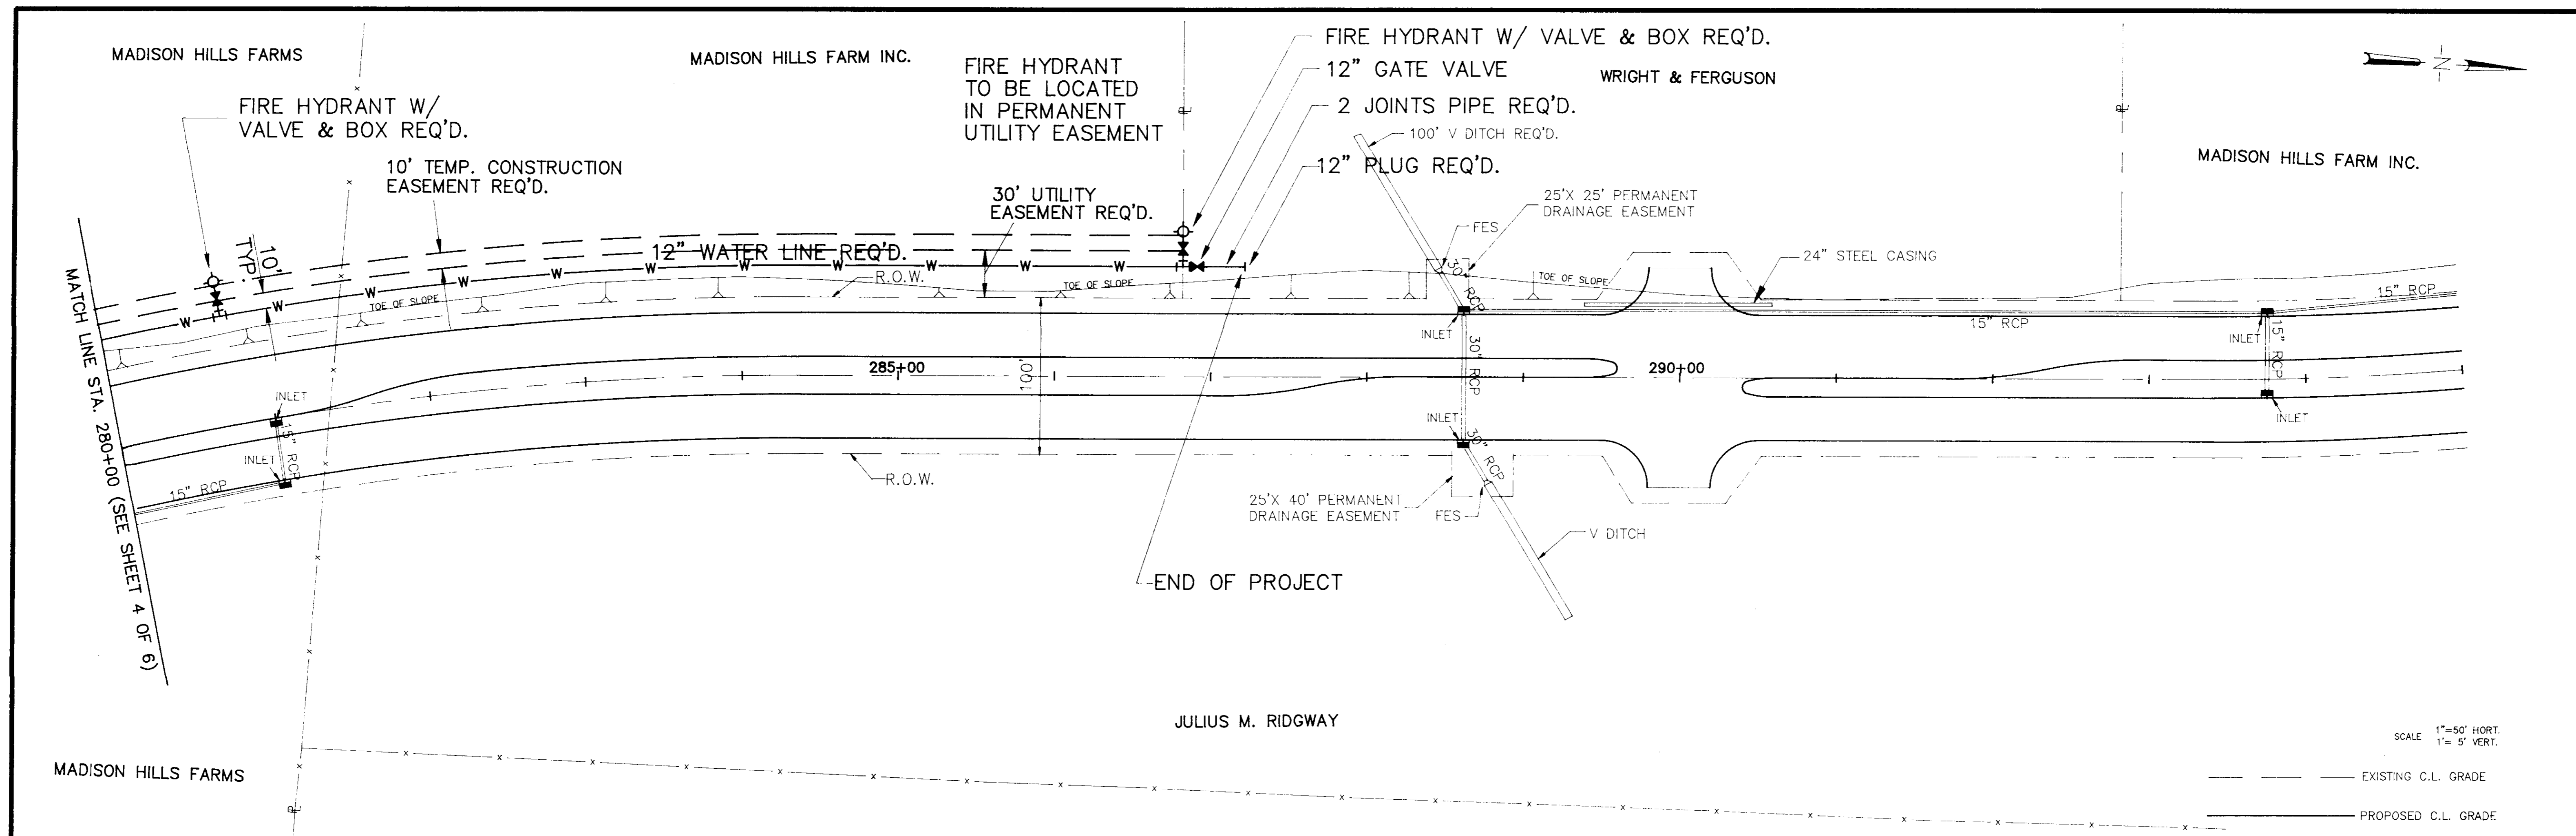


2	B-24-93	ADD FIRE HYDRANT & REMOVE 10' TEMP. CONST. ESMT. ON NORTH END.	J.P.	DESIGNED	DATE
1	5-12-93	ADDED NOTES & REVISED TITLE BLOCK	C.S.	W.L.M.	3-30-93
NO.	DATE	REVISIONS	BY	C.S.	SCALE AS SHOWN

WAGCONER ENGINEERING INC. CONSULTING ENGINEERS
 JACKSON, BRANDON / PASCAGOULA, MISSISSIPPI
 CITY OF RIDGELAND
 PARKWAY WATER MAIN-NORTH OF STEED RD.
 STA.280+00 TO STA.287+00
 ACAD PATH ROUTE
 G.VERNIE P.93019, PPR03
 W.E.I. JOB NO. 93-019 SHEET NO. 5 OF 6

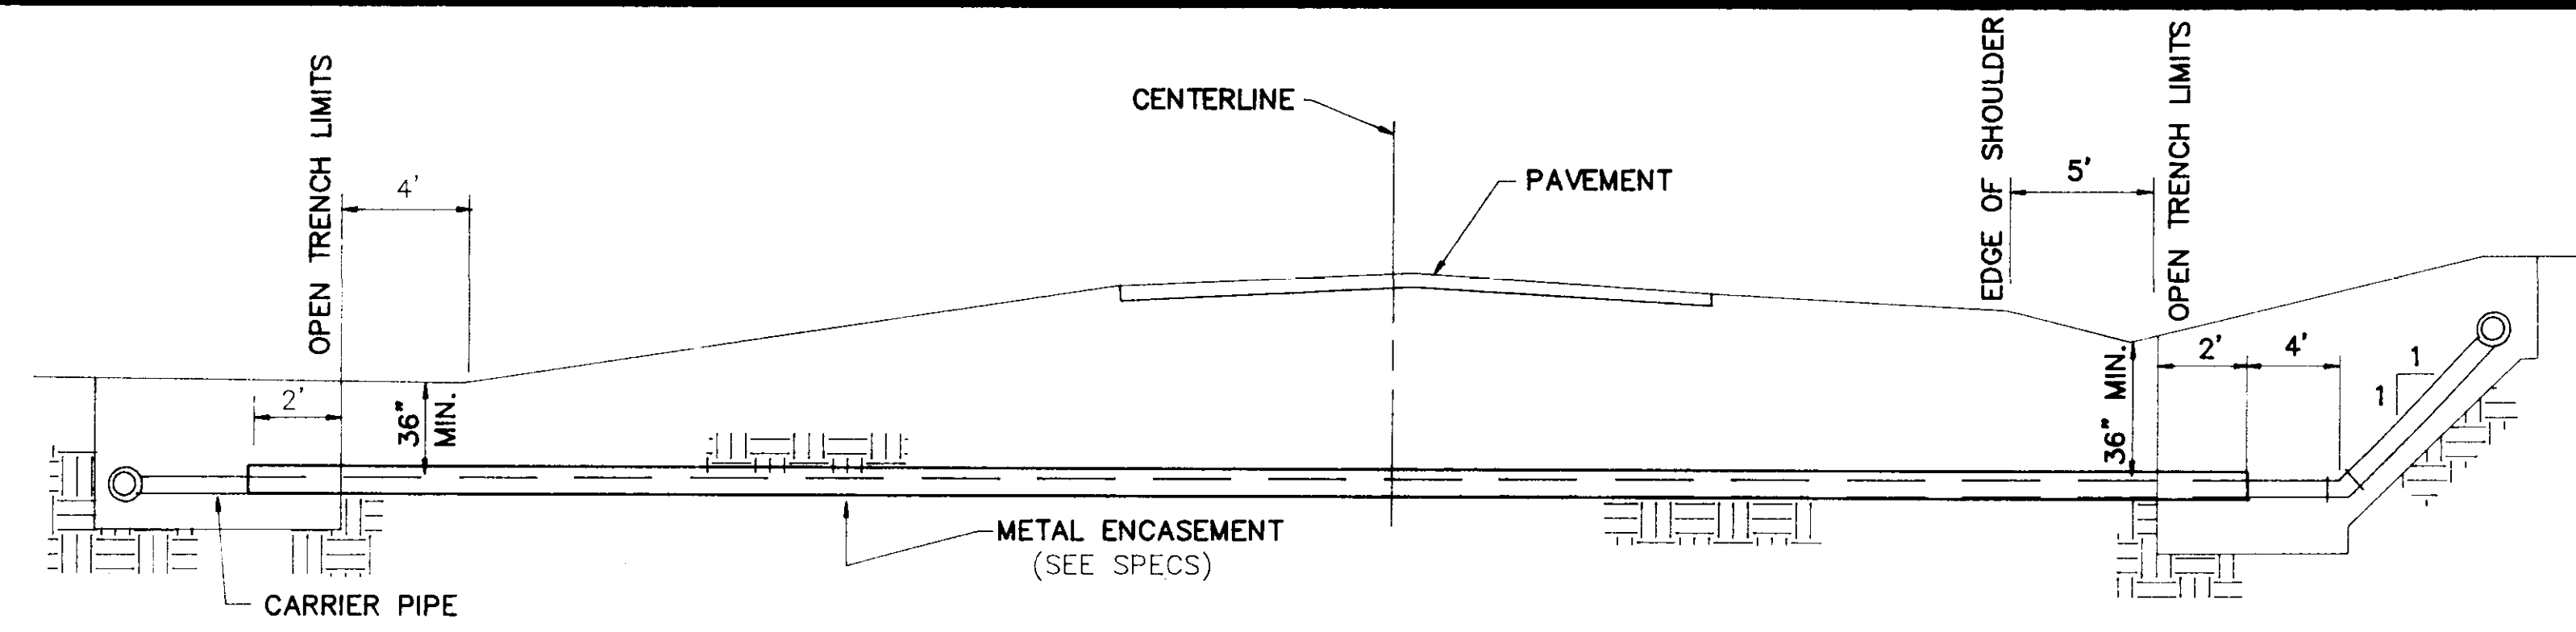


TYPICAL CASED CROSSING


NOTE: COMPENSATION FOR CONCRETE THRUST BLOCKS SHALL BE INCLUDED IN THE UNIT PRICE BID FOR VALVES, FIRE HYDRANTS AND FITTINGS.

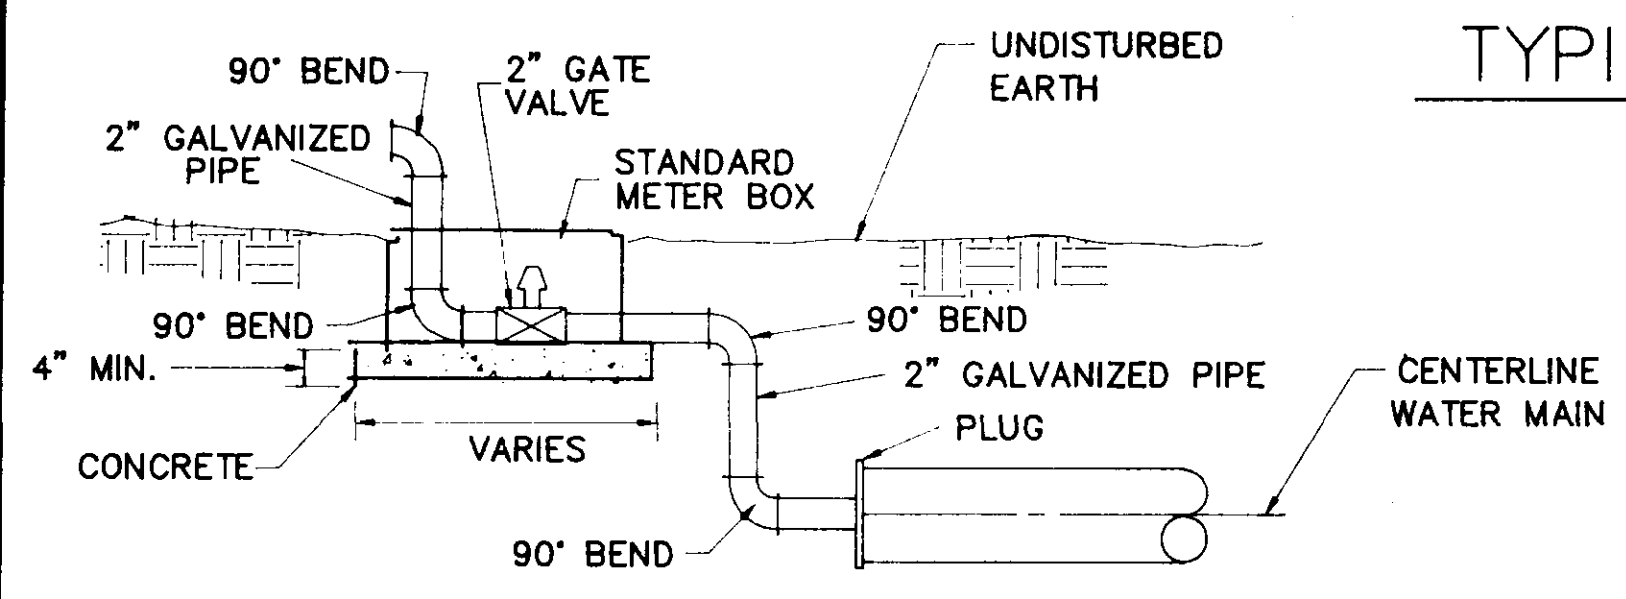


TYPICAL 2" BLOW-OFF DETAIL

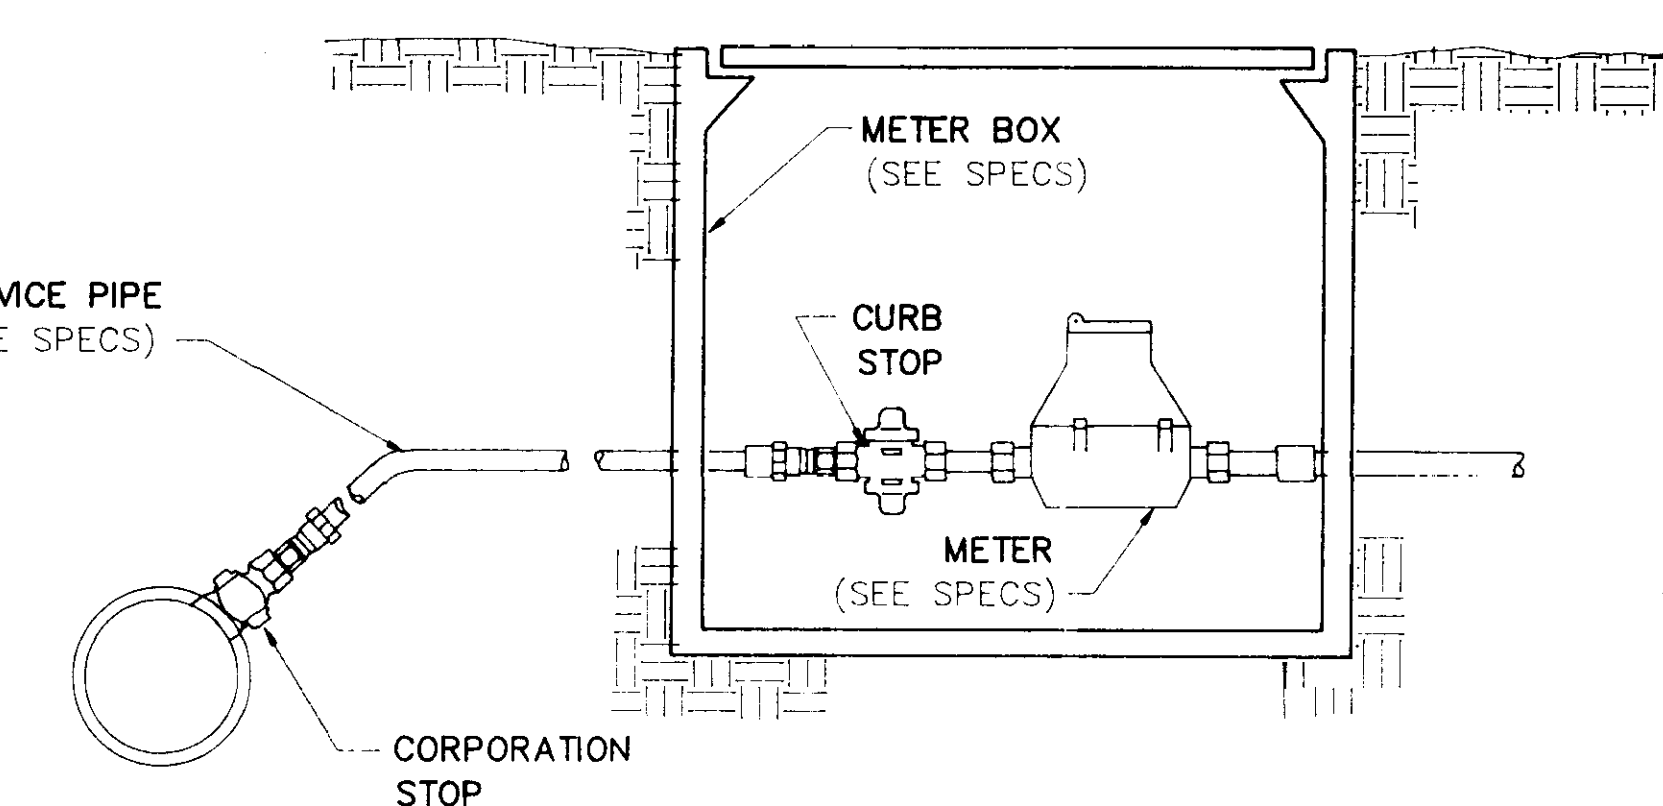

TYPICAL SERVICE ASSEMBLY

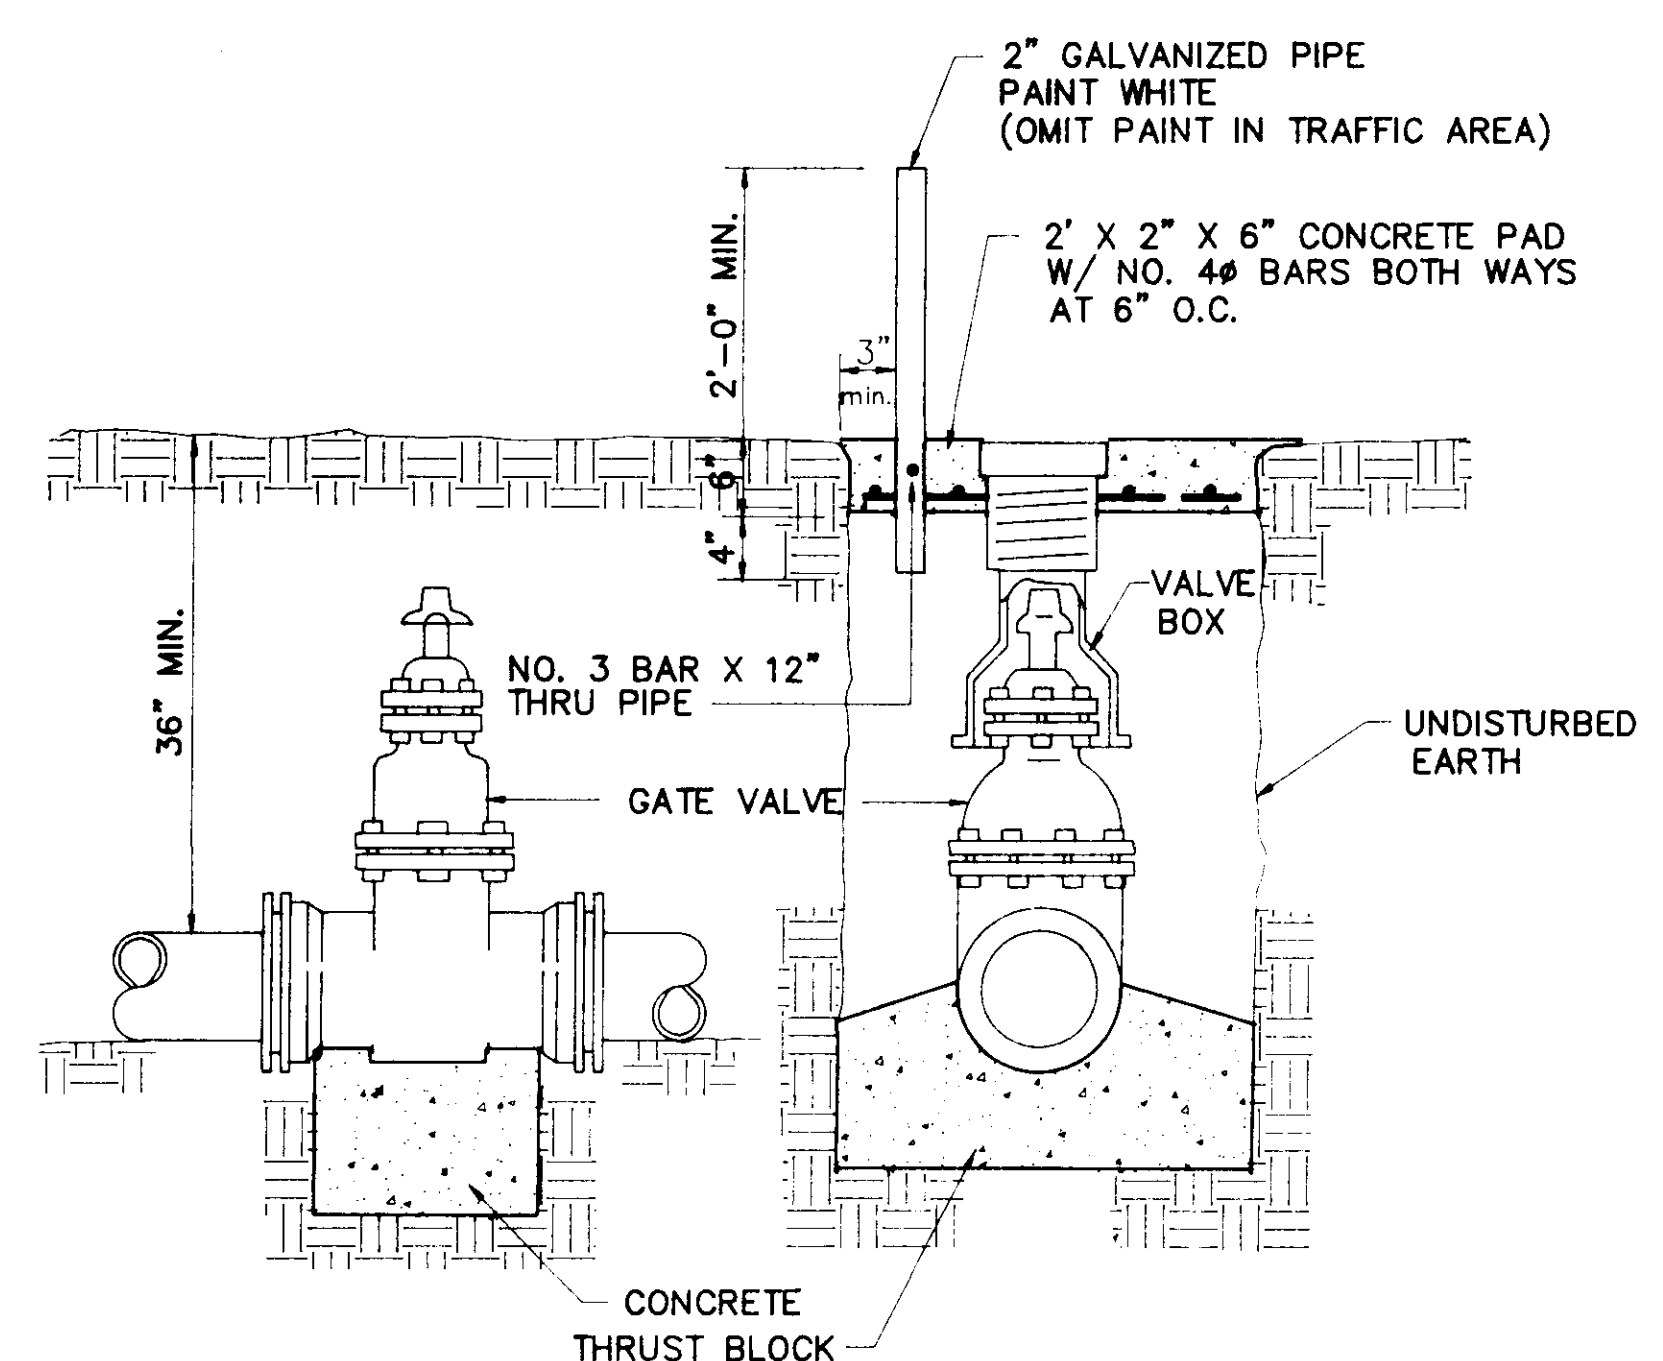


ELEVATION SECTION
TYPICAL VALVE & BOX

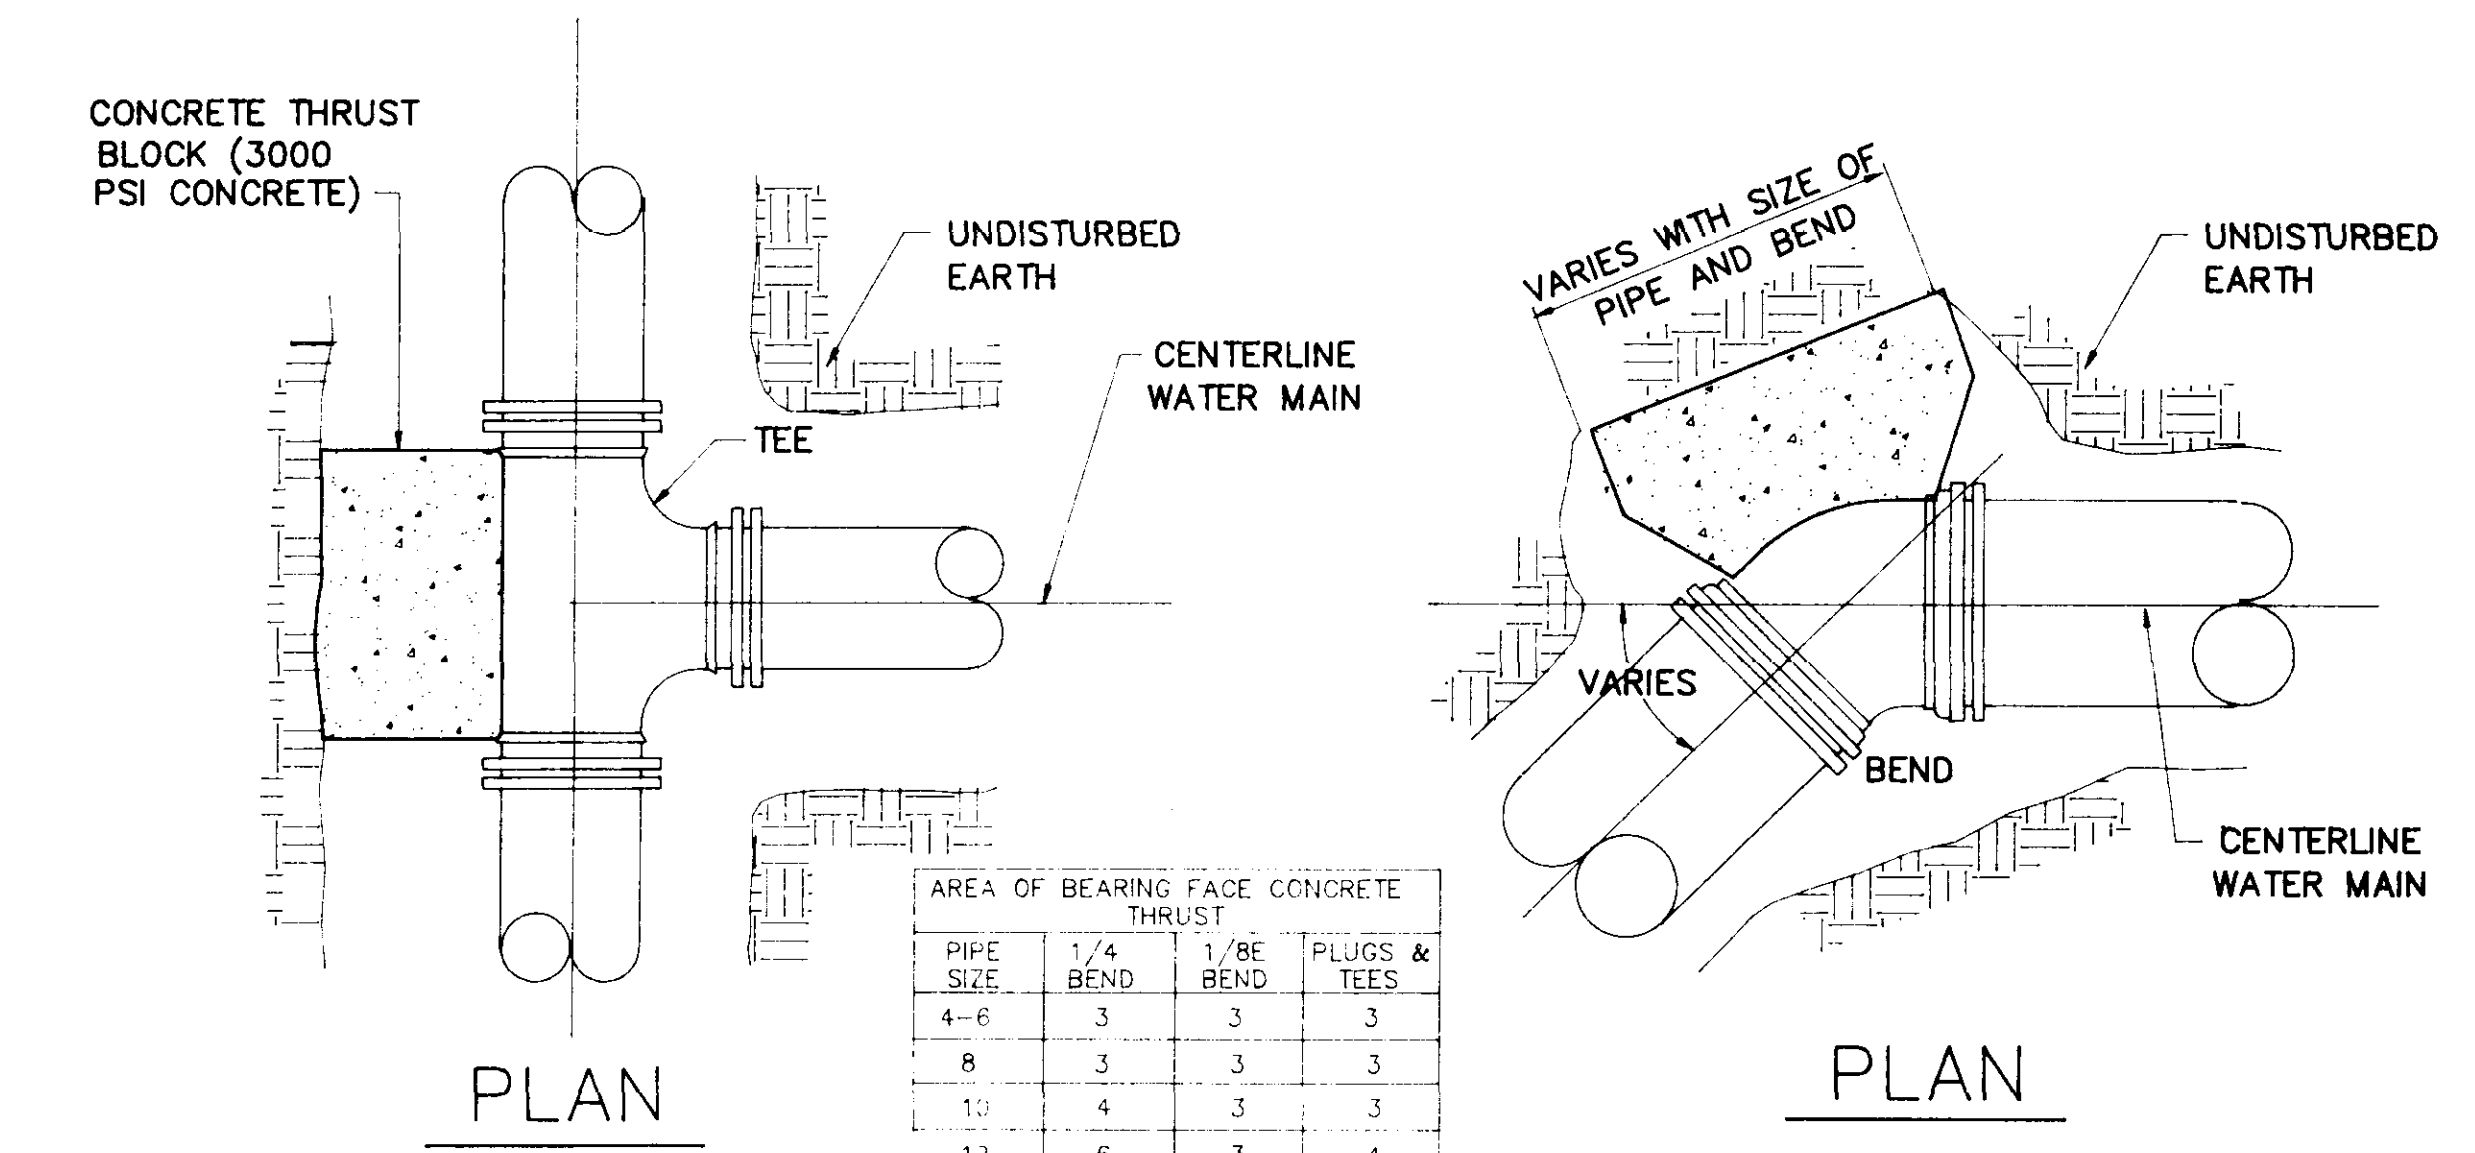

PLAN

PLAN


PIPE SIZE	1/4 BEND	1/8 BEND	PLUGS & TEES
4-6	3	3	3
8	3	3	3
10	4	3	3
12	6	3	4
16	11	4	7

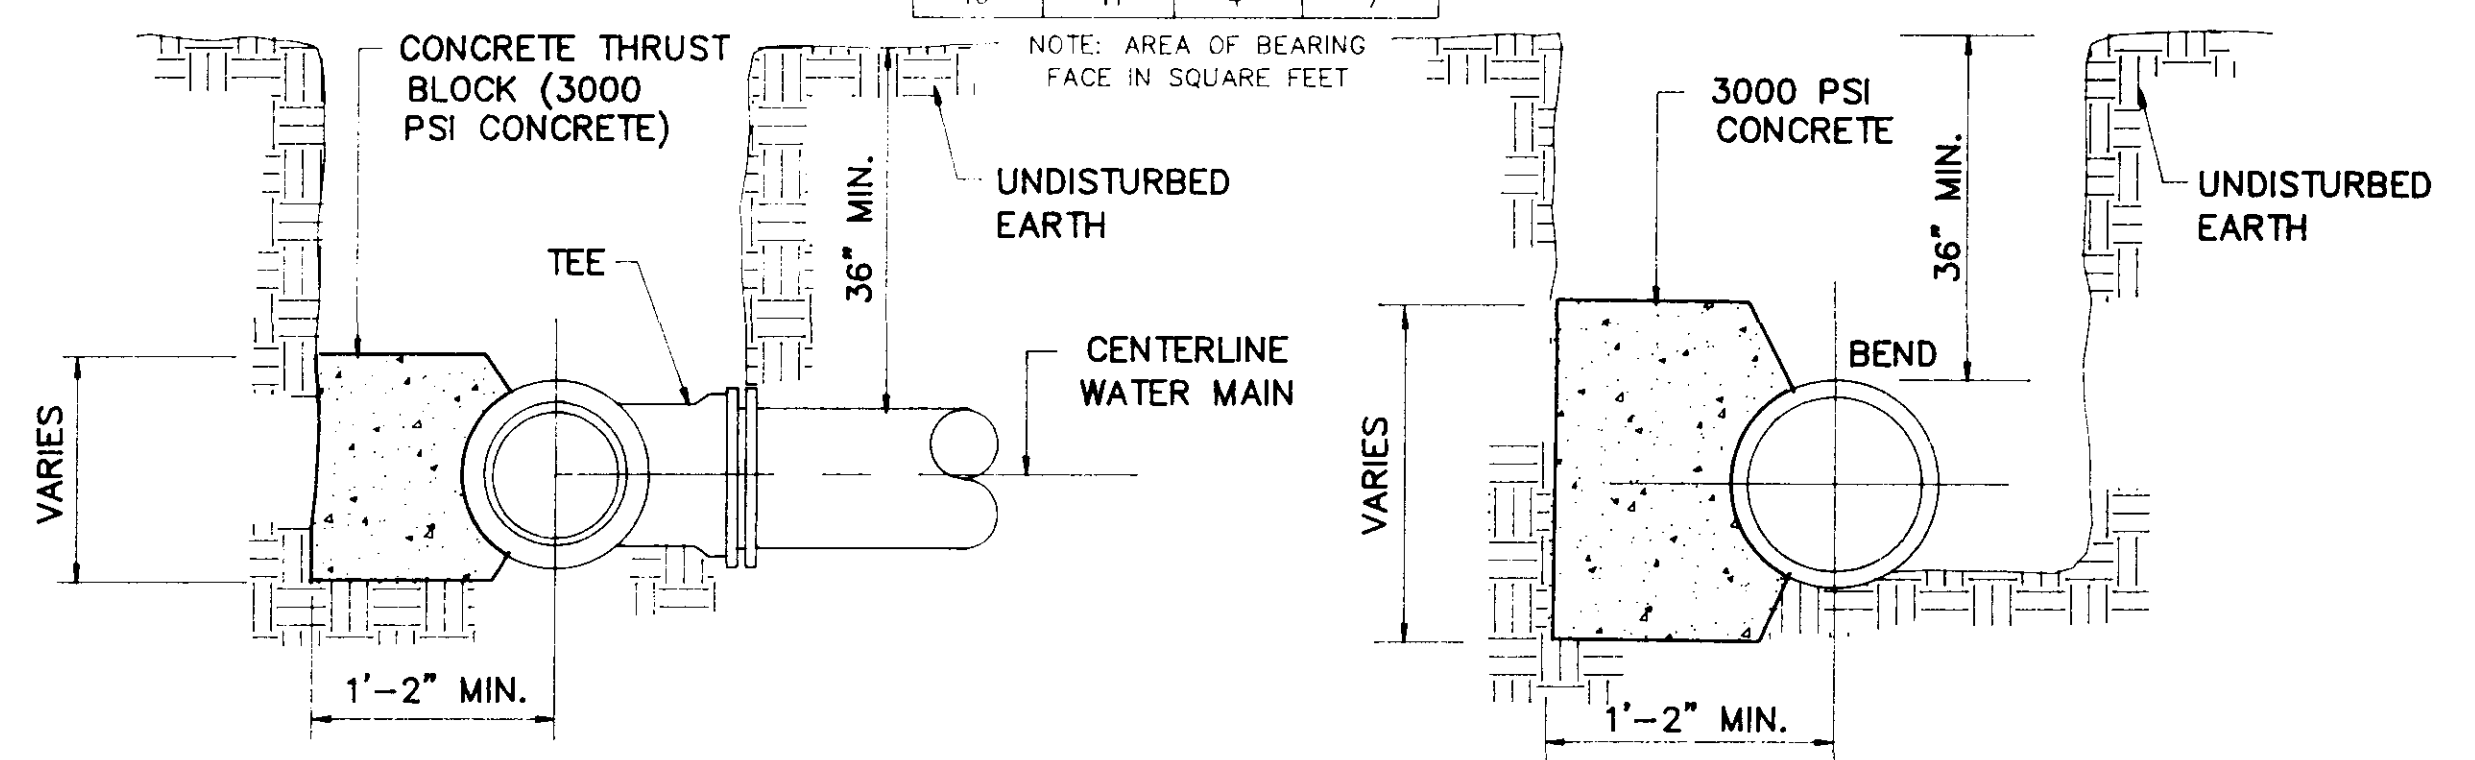


SECTION

SECTION


BLOCKING DETAILS FOR TEES & BENDS

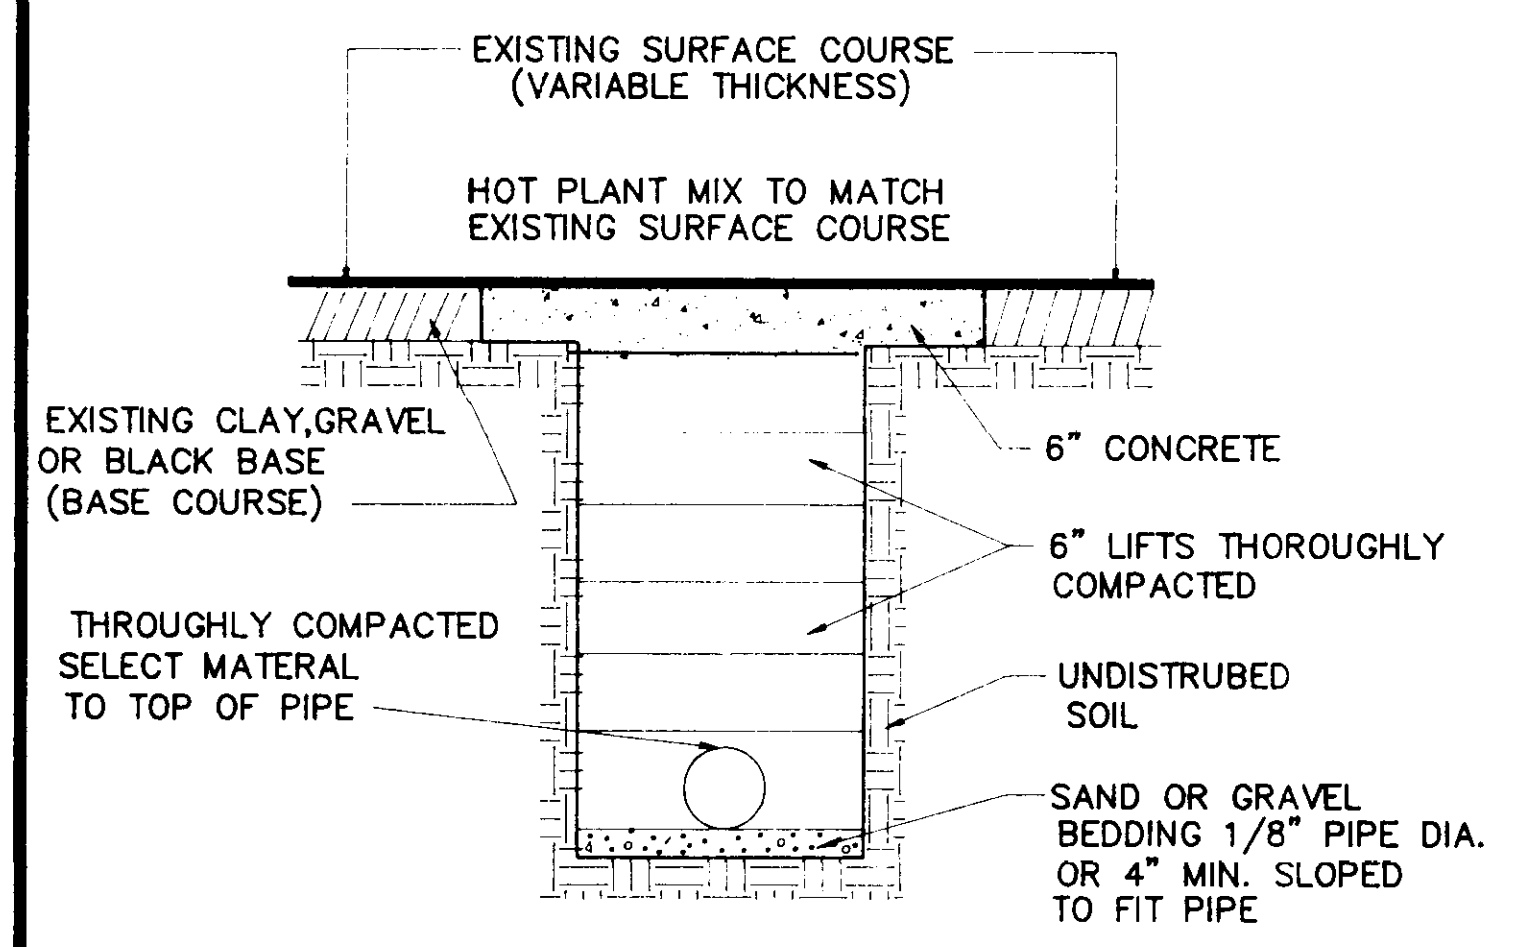

STREET REPAIR OF OPEN CUT

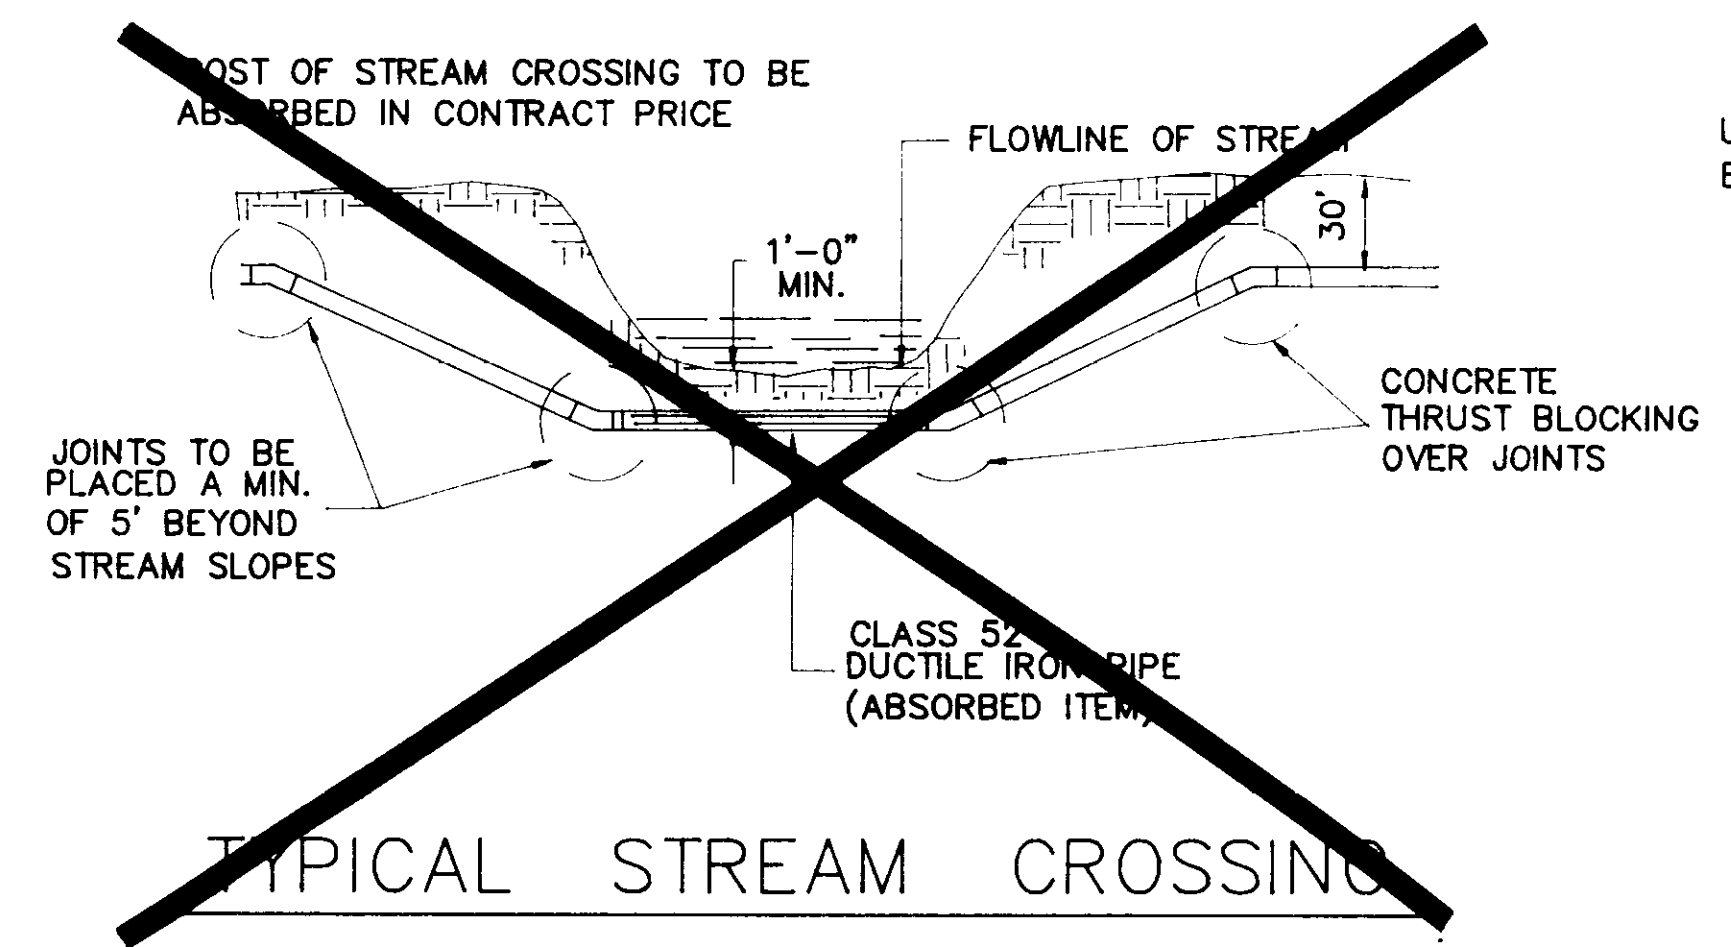

TYPICAL STREAM CROSSING

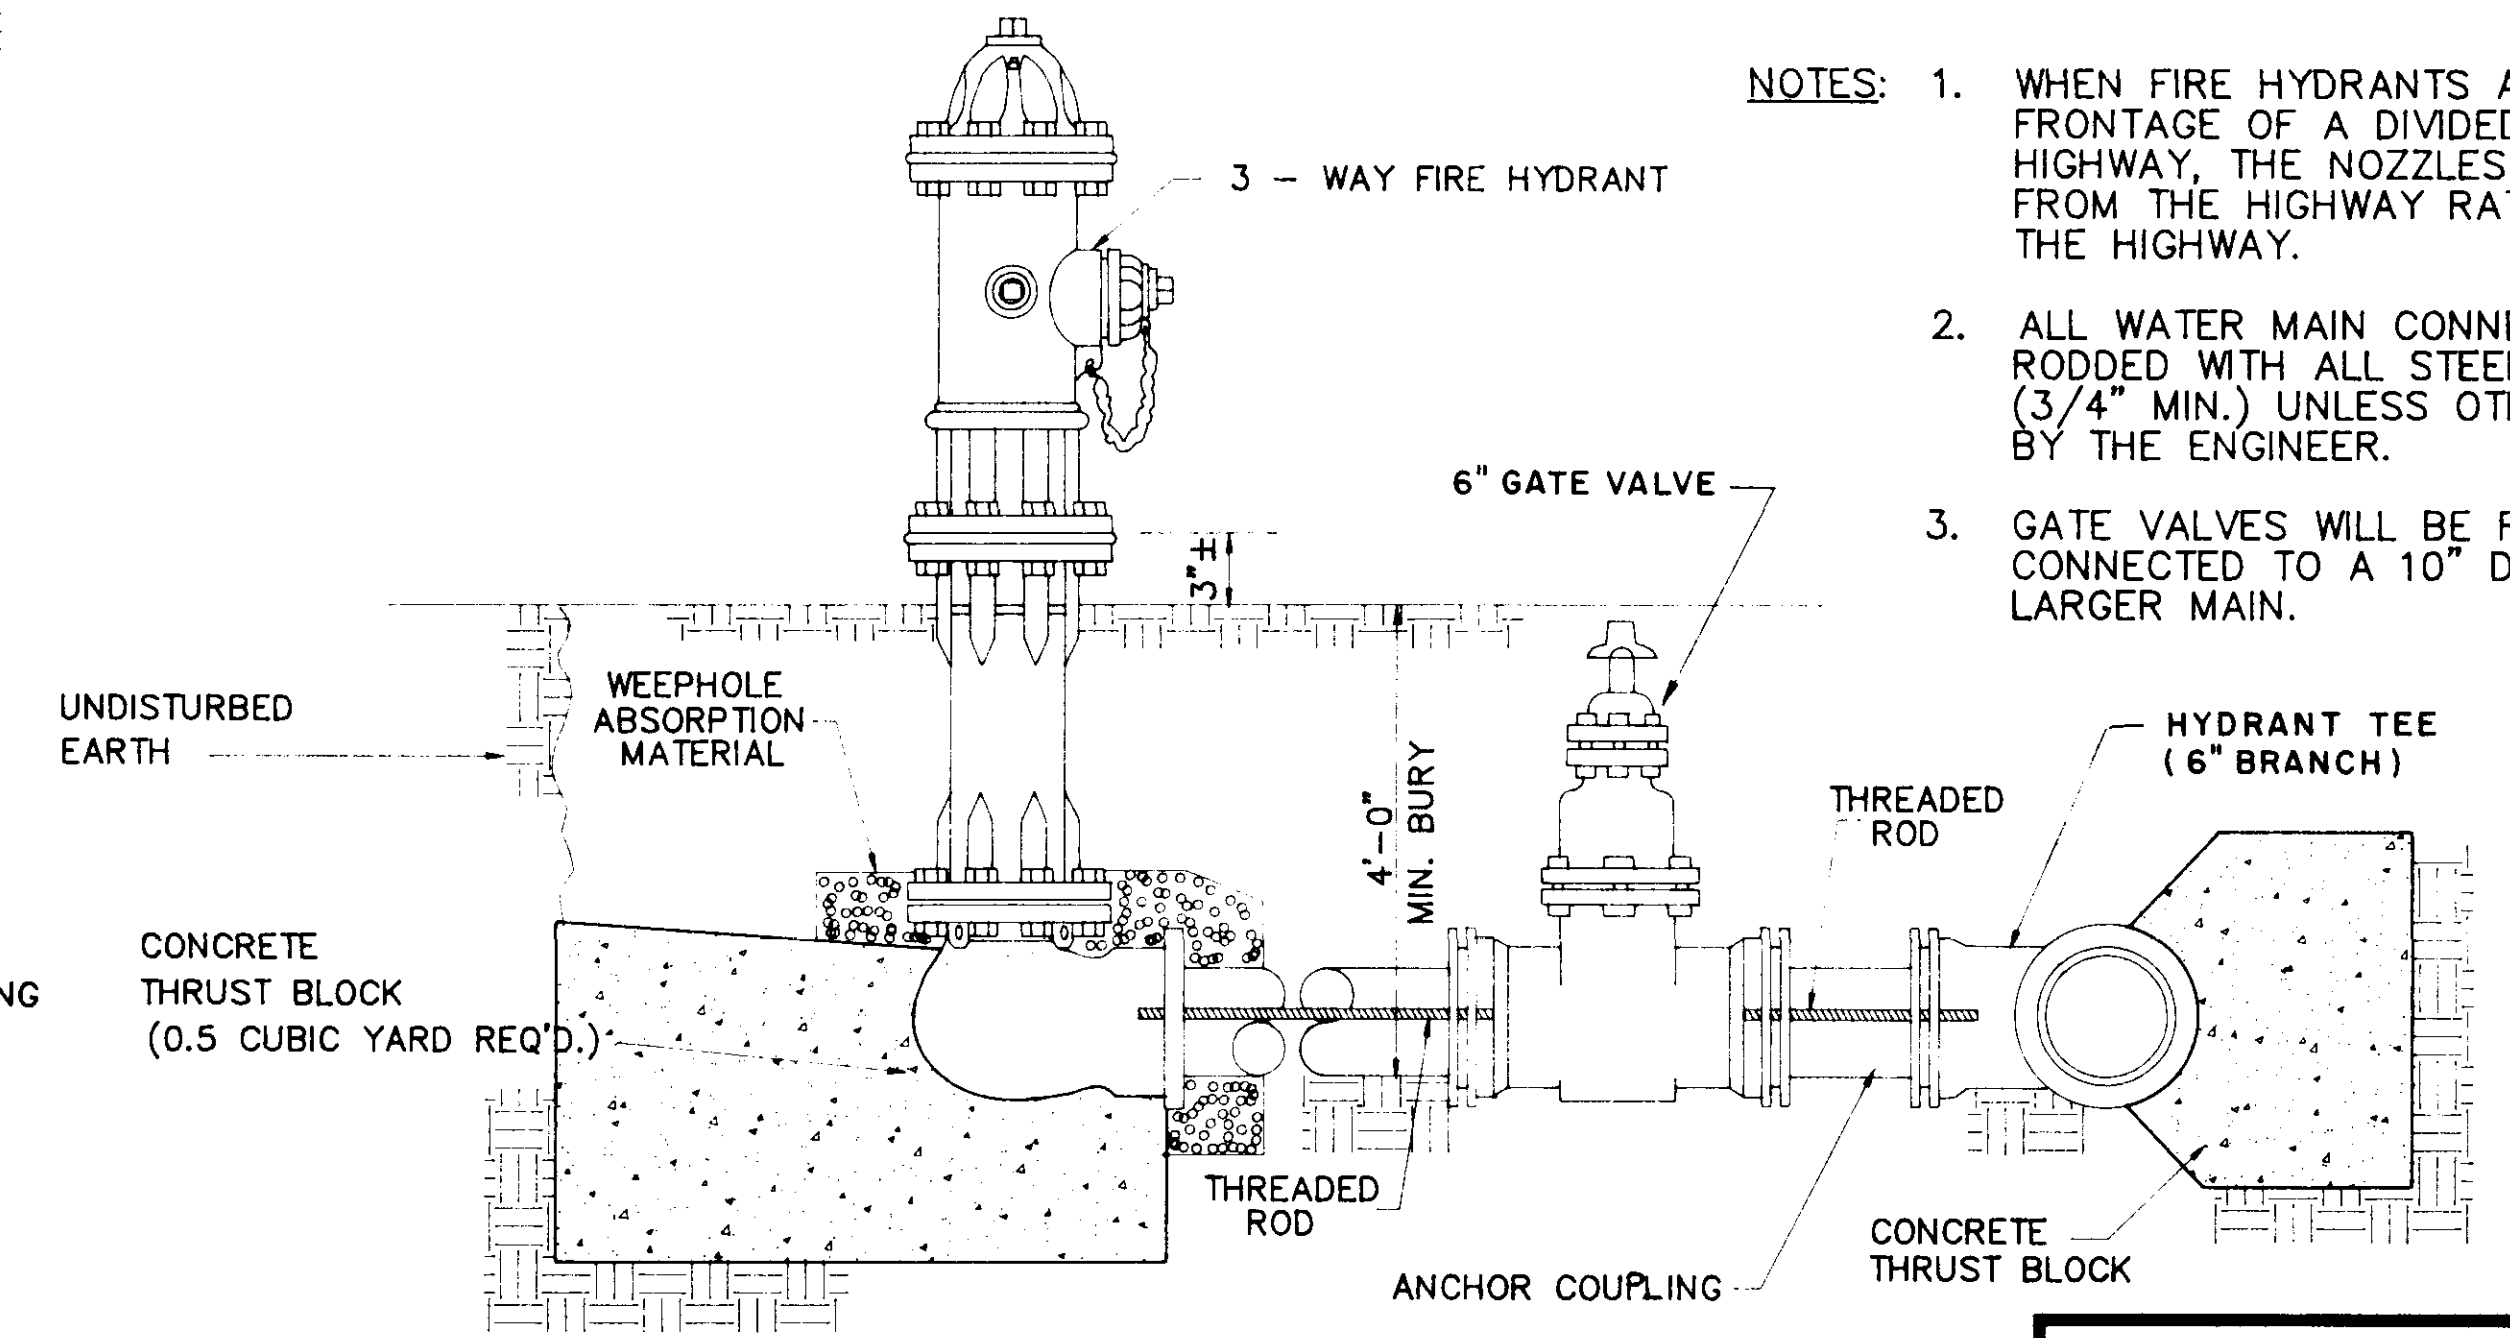

TYPICAL FIRE HYDRANT ASSEMBLY

- NOTES:
1. WHEN FIRE HYDRANTS ARE PLACED ON THE FRONTAGE OF A DIVIDED OR MULTI-LANE HIGHWAY, THE NOZZLES SHALL FACE AWAY FROM THE HIGHWAY RATHER THAN TOWARD THE HIGHWAY.
 2. ALL WATER MAIN CONNECTIONS SHALL BE RODDED WITH ALL STEEL THREADED RODS (3/4" MIN.) UNLESS OTHERWISE INSTRUCTED BY THE ENGINEER.
 3. GATE VALVES WILL BE REQUIRED WHEN CONNECTED TO A 10" DIAMETER OR LARGER MAIN.

CITY OF RIDGLAND		
PARKWAY WATER MAIN		
NORTH OF STEED ROAD		
WATER STANDARD DETAILS		
WAGGONER ENGINEERING, INC.		
Consulting Engineers - Jackson, Brandon, Pascagoula, Mississippi		
DRAWN BY: C.S.	DATE: 2-24-93	SHEET NUMBER
REVIEWED BY: W.L.M.	SCALE: NTS	6 OF 6